


| | | | |
|-----------|----------------|---------------|-------|
| MODEL | RATING | ELEMENT SPLIT | |
| DFC2400TI | 2400W 230-240V | 1200W | 1200W |

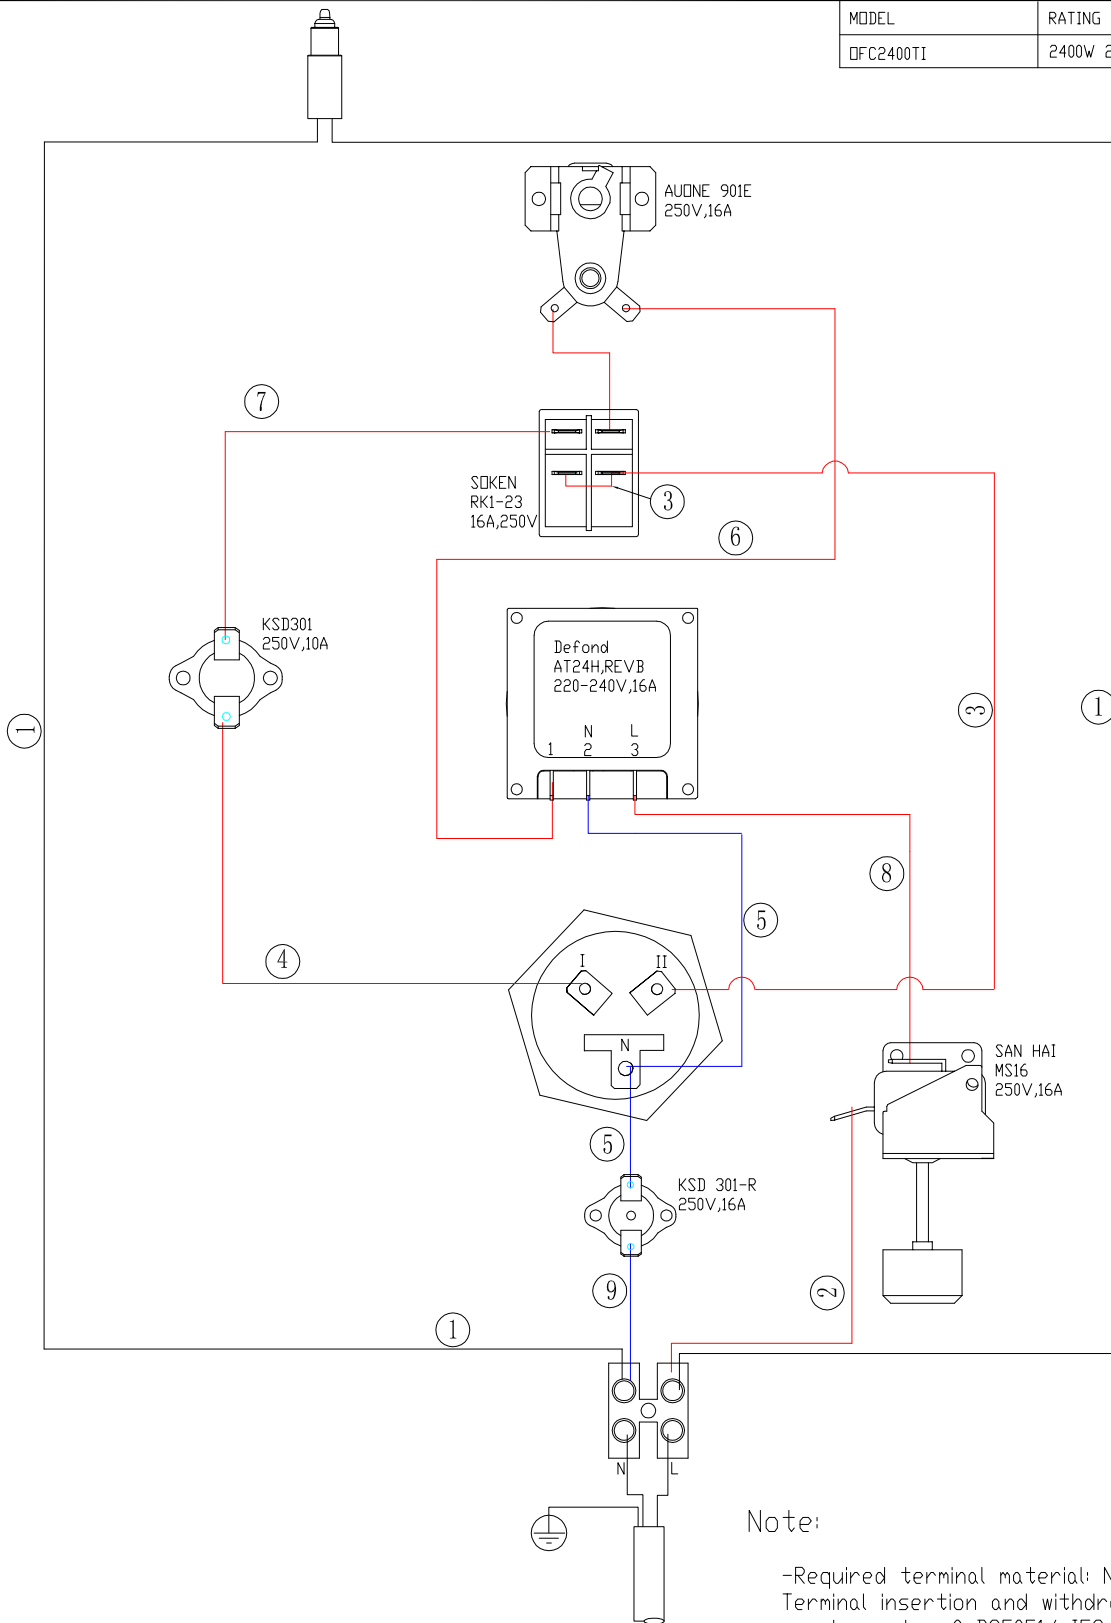

Note:

- Required terminal material: Nickel Plated Steel Terminal insertion and withdrawal force to meet requirements of BS5051/ IEC 760
- Wire lengths & terminal orientation/type to be confirmed by Cuori

| | | | | | | |
|-------|----------------------|-------|----------|---|---|--|
| ISSUE | MODIFICATIONS | APP'D | DATE | NOTES | <p>Dunleer, Co.Louth, Ireland. Tel: 041 9800204. Fax: 041 6851464.</p> | <p>THIS DRAWING IS SUPPLIED IN CONFIDENCE AND THE COPYRIGHT THEREOF IS THE PROPERTY OF GLEN DIMPLEX; IT MUST NOT BE USED BY A THIRD PARTY WITHOUT PRIOR PERMISSION. ©2006</p> <p>PROJECT: GDA - DFC 2400TI</p> |
| A | RELEASE FOR SAMPLING | DF | 18/11/08 | <p>All wires to be 1.0mm²</p> <p>Neon function: Mains On</p> <p>Tolerance on all wire lengths +/-5mm</p> | | |
| | | | | <p>DO NOT SCALE</p> <p>IF IN DOUBT ASK</p> | <p>THIRD ANGLE PROJECTION</p> | <p>DRG NO: 0/11582/0</p> |
| | | | | | <p>R.o.H.S.</p> <p>All material must comply with the requirements of European Directive 2002/95/EC on the restriction of the use of certain hazardous substances.</p> | <p>A4 Sht 1 of 1</p> |